





Peerless of America
Since 1912

EFFINGHAM, IL 62401
INSTALLATION INFORMATION, DIMENSIONS &
SPECIFICATIONS

**POWER PACK (P)
UNIT COOLER
MEDIUM TEMPERATURE**

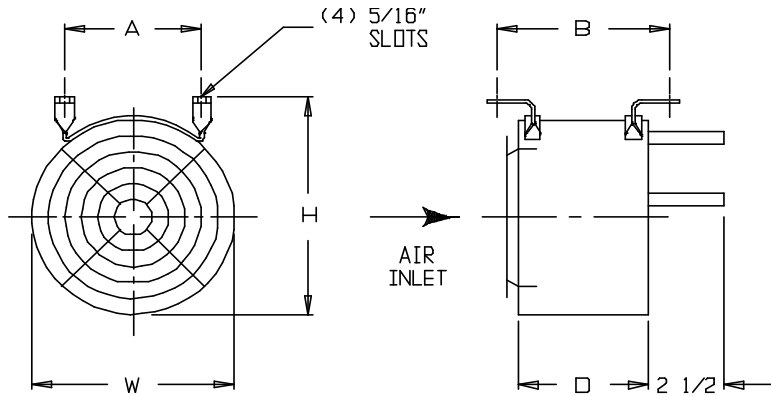

This unit can be ceiling mounted (left) or wall mounted (below).

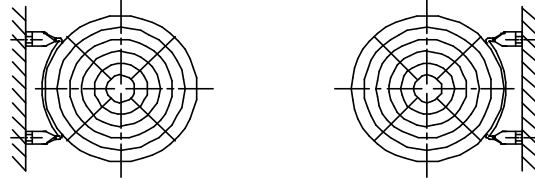

DIMENSIONS

Model No.	Dimensions (Inches)			Mounting Hole Locations		Connections			Approx. Ship. Wt. Lbs.
	H	W	D	A	B	Inlet	Suction	Drain	
P-82S	8 7/8	8 7/8	4 1/2	6 3/4	6 1/8	3/8" OD	3/8" OD	-	7
P-83S	8 7/8	8 7/8	5 1/2	6 3/4	7 1/8	3/8" OD	3/8" OD	-	9
P-103S	10 7/8	10 7/8	5 1/2	8 1/4	6 7/8	3/8" OD	3/8" OD	-	12
P-104S	10 7/8	10 7/8	6 1/2	8 1/4	7 7/8	3/8" OD	3/8" OD	-	14

PEERLITE protective coated coils designated by a "-P" after model number.

SPECIFICATIONS

Model No.	BTU/HR		CFM	Fan Dia.	Motor Amps	
	10° TD	15° TD			115 V	230 V
P-82S	850	1275	150	8"	0.73	0.45
P-83S	1100	1650	150	8"	0.73	0.45
P-103S	1350	2025	200	10"	0.73	0.45
P-104S	1600	2400	200	10"	0.73	0.45

Standard 115/60/1 (230/60/1 optional)

GENERAL SAFETY INFORMATION

1. Only personnel qualified and familiar with this type of equipment should be responsible for the installation, service and maintenance of these units.
2. Disconnect all power sources prior to installing, servicing, or maintaining these units.
3. All field wiring must conform to equipment requirements and all applicable national, state and municipal codes.
4. Reduce potential for injury by avoiding direct contact with sharp edges and coil surfaces when handling these units.

We reserve the right to make changes in design and construction at any time without notice.

July-15
PP# 05106