




Peerless of America
Since 1912

EFFINGHAM, IL 62401
INSTALLATION INFORMATION, DIMENSIONS &
SPECIFICATIONS

**MID JETTE (MJ)
UNIT COOLER
MEDIUM TEMPERATURE
AIR DEFROST**

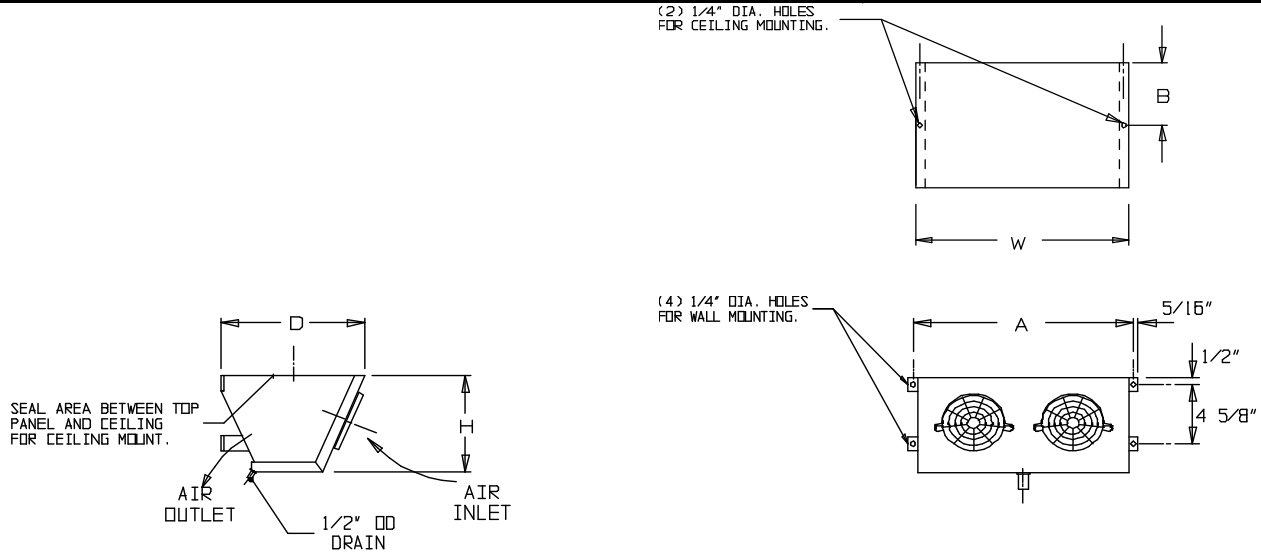

DIMENSIONS

Model No.	Dimensions (Inches)			Mounting Hole Locations		Connections			Approx. Ship. Wt. Lbs.
	H	W	D	A	B	Inlet	Suction	Drain	
MJ-40	7	13 5/8	8	13	3 3/4	3/8" OD	3/8" OD	1/2" OD	7
MJ-70	7	13 5/8	8	13	3 3/4	3/8" OD	3/8" OD	1/2" OD	9
MJ-90	7	13 5/8	9	13	4 3/4	3/8" OD	3/8" OD	1/2" OD	10
MJ-120	7	20 5/8	9	20	4 3/4	3/8" OD	3/8" OD	1/2" OD	15

PEERLITE protective coated coils designated by a "-P" after model number.

SPECIFICATIONS

Model No.	BTU/HR		CFM	Fan Dia. (Quantity)	STD. Motor Amps	
	10° TD	15° TD			115 V	230 V
MJ-40	400	600	125	5 1/4"	0.65	0.35
MJ-70	700	1050	125	5 1/4"	0.65	0.35
MJ-90	900	1350	125	5 1/4"	0.65	0.35
MJ-120	1200	1800	250	5 1/4 (2)	1.30	0.70

Standard 115/60/1 (230/60/1 optional)

GENERAL SAFETY INFORMATION

1. Only personnel qualified and familiar with this type of equipment should be responsible for the installation, service and maintenance of these units.
2. Disconnect all power sources prior to installing, servicing, or maintaining these units.
3. All field wiring must conform to equipment requirements and all applicable national, state and municipal codes.
4. Reduce potential for injury by avoiding direct contact with sharp edges and coil surfaces when handling these units.

We reserve the right to make changes in design and construction at any time without notice.

July-15
PP# 05100